


Automat 2" Model 144M

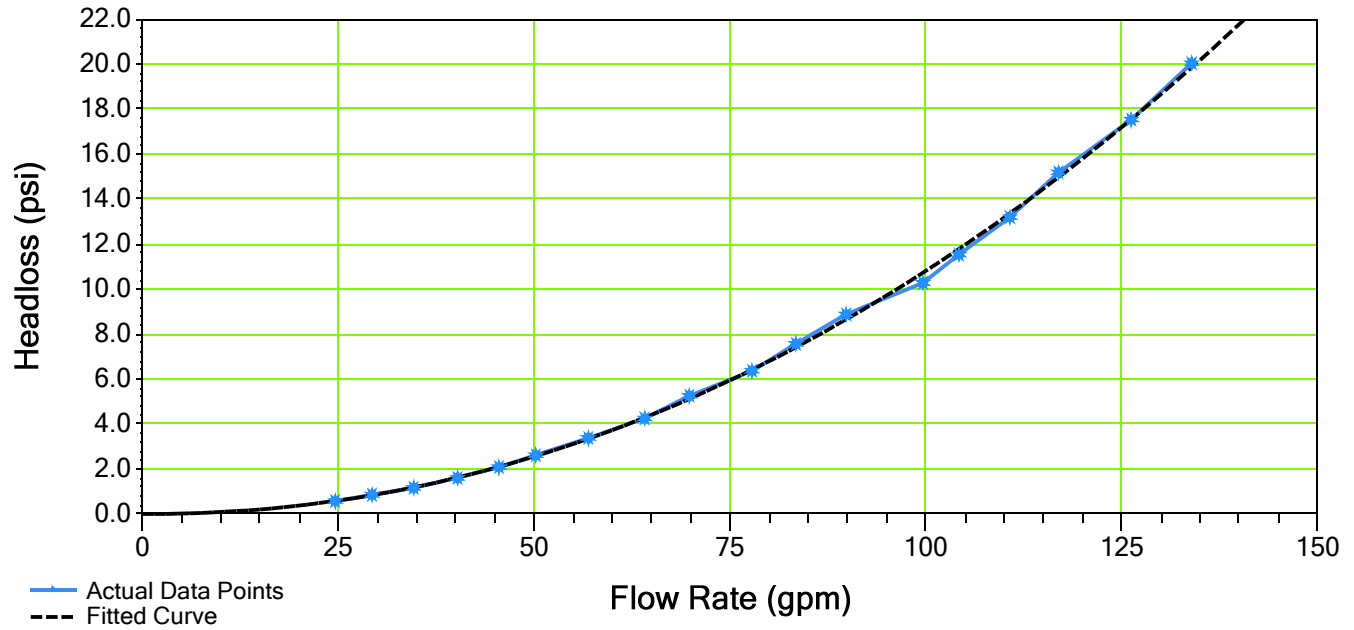

Test psi: 50.0

HL = 0.000750261800 Q².07958
R² = 1.000
CV = 30.9

Test Date: 01/16/15

Flow Rate (gpm)	Headloss (psi)	Estimate	Residual
24.6	0.58	0.59	1.0 %
29.3	0.86	0.84	-2.1 %
34.6	1.17	1.19	1.7 %
40.2	1.61	1.63	1.0 %
45.5	2.09	2.10	0.7 %
50.2	2.62	2.58	-1.5 %
56.9	3.38	3.35	-0.9 %
64.1	4.26	4.29	0.8 %
69.8	5.26	5.12	-2.6 %
77.8	6.37	6.42	0.8 %
83.4	7.57	7.42	-2.0 %
89.8	8.88	8.65	-2.6 %
99.6	10.28	10.73	4.2 %
104.2	11.54	11.79	2.1 %
110.7	13.20	13.37	1.3 %
116.9	15.19	14.98	-1.4 %
126.2	17.54	17.56	0.1 %
133.9	20.05	19.86	-0.9 %